



中盛弘宇建设科技有限公司
Zhongheng Hongyu Construction Technology Co., Ltd.

工程设计资质证书编号
建筑甲级:A113007169
园林甲级:A113007169
规划乙级:城规142010
市政乙级:A213007166
人防乙级:A213007166

备注 NOTE
*本图经施工图审查机构及消防审批部门审查合格方可用于施工。
版权所有中盛弘宇建设科技有限公司所有，未经许可，不得翻
印使用，更改和复制等其它用途。
This drawing can only be used for construction after being
examined to be qualified and approved by Drawing Appraisal
Unit & Fire Control Committee. The copyright belongs to the
Zhongheng Hongyu Construction Technology Co., Ltd. Without
written permission, it's prohibited to use, change or copy
the drawing for other purposes.

合作设计单位 CO-OPERATED WITH

说明 EXPLAIN

审 定 APPROVED BY	支永涛	支永涛
审 核 VERIFIED BY	李 亮	
项目负责人 PROJECT CHIEF	宋志荣	宋志荣
专业负责人 PROFESSION CHIEF	支永涛	支永涛
校 对 CHECKED BY	周兴	周兴
设 计 DESIGNED BY	周浪	周浪

建设单位 CONSTRUCTION

重庆华牧现代农业有限公司

工程名称 PROJECT

华牧现代农业生态循环智能化康鸡项目配电工程

项目名称 SUB PROJECT

图纸名称 DRAWING TITLE

电缆排管施工图(2回)

工程编号

图号 NO.

阶段

施工图

专业

电 气

比例

1:1

图号



日期

2023.04

版本号

A

签字齐全 盖章有效

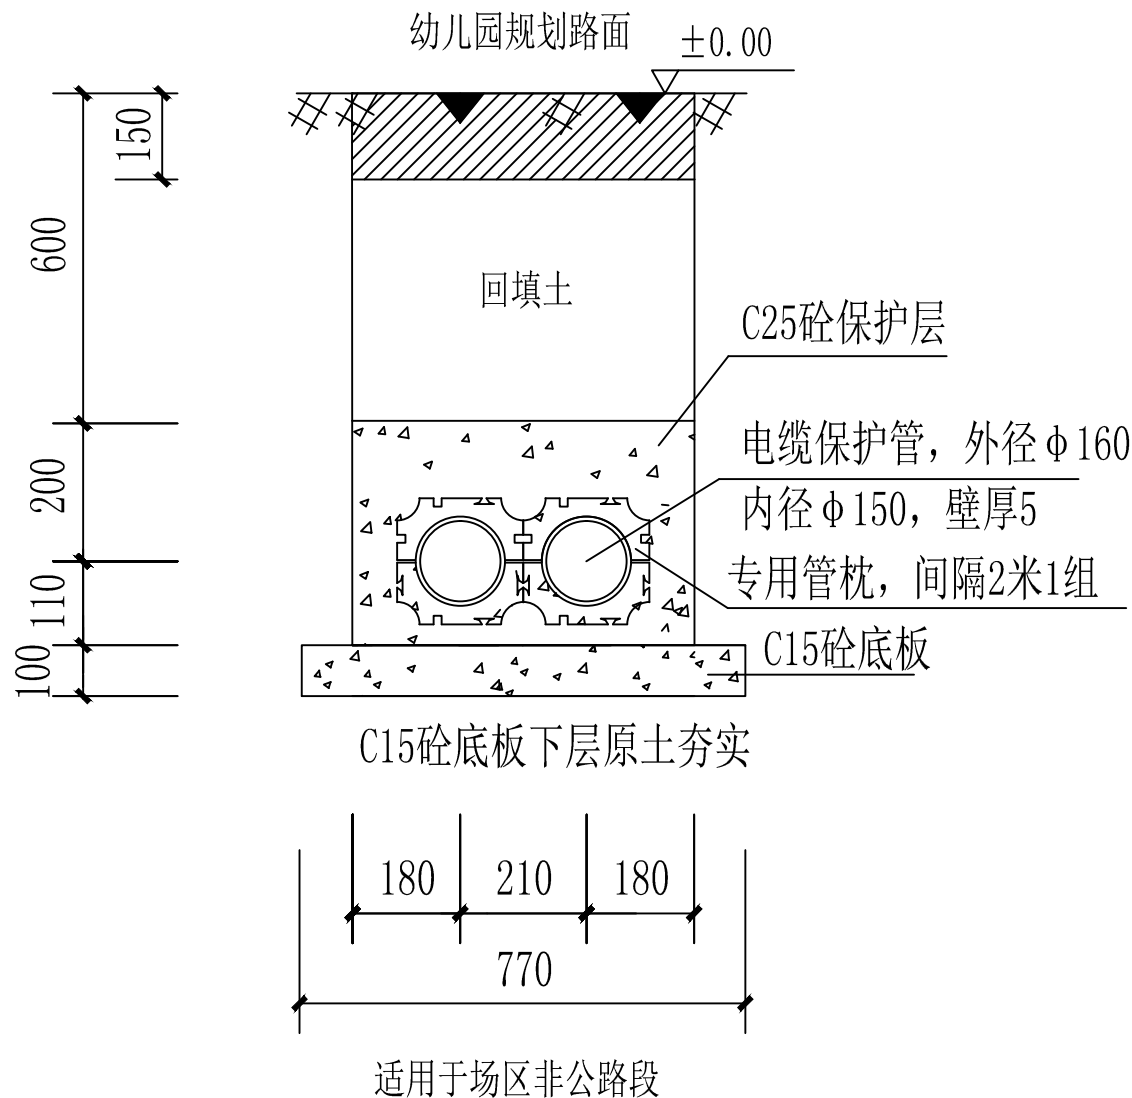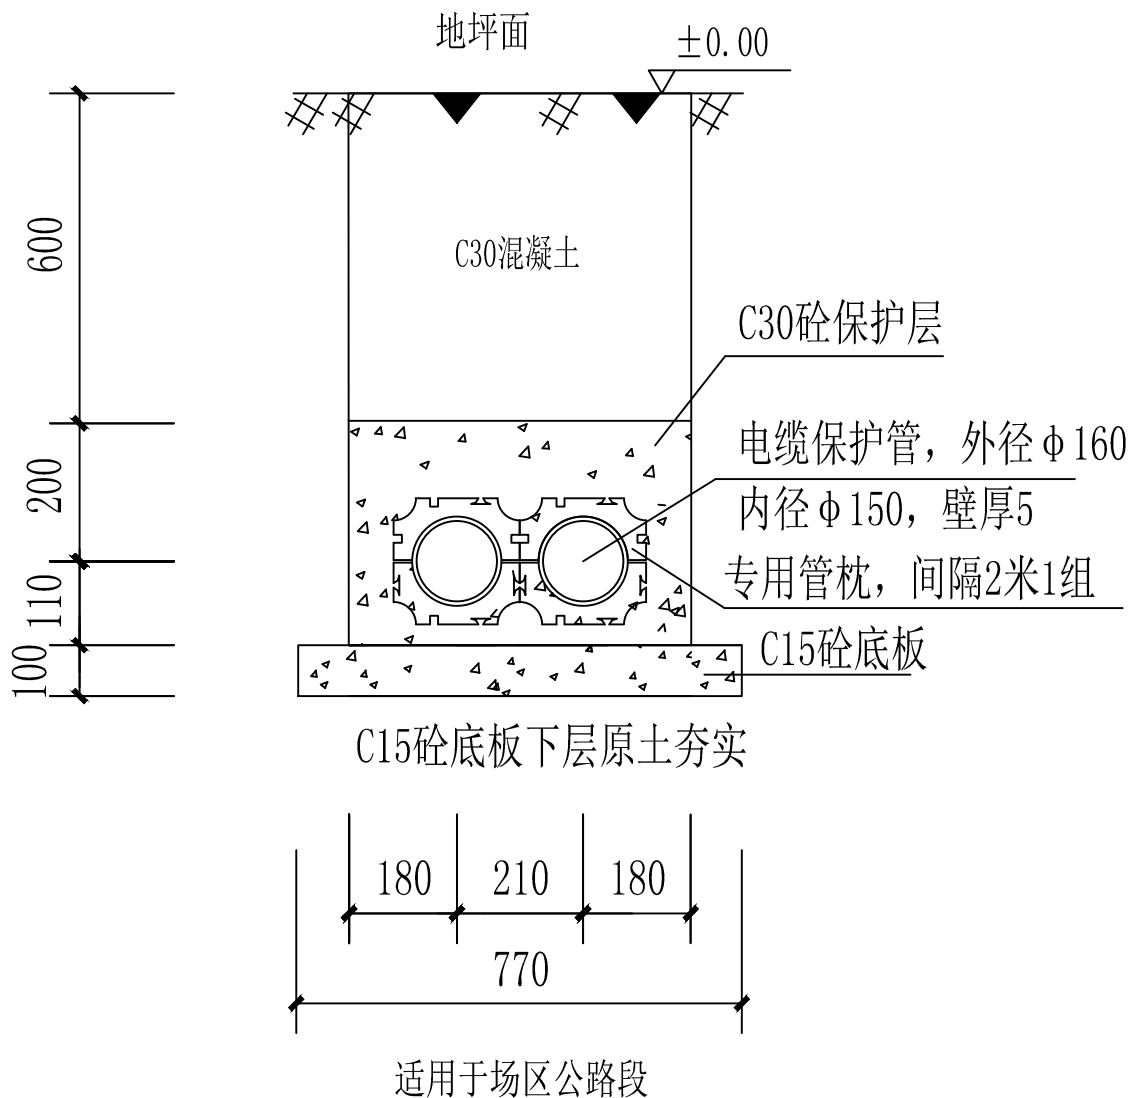

电力电缆管与其它管道、建筑物之间的最小净距

项目	平行(m)	交叉(m)
热管道及热力设备	2.0	0.5
可燃气体及易燃液体管道	1.0	0.5
油管道	1.0	0.5
其它管道	0.5	0.5
排水沟	1.0	0.5
公路	1.5	1.0
城市街道路面	1.0	0.7
建筑物基础	0.6	

说明:

- 电缆保护管采用CPVC硬塑管,管外径如图所示。
- 电缆保护用CPVC硬塑管若需接头时,接口应粘接平整,内壁须无毛刺。
- 本电力护套管理设时应考虑3%的泄水坡度。
- 电力护套管与工作井连接时应衔接紧密,井口与管壁齐平。